




Utility Final

Inspection Form

Job Location:	Date of Inspection:
Permit Number:	Inspector:
Owner Name:	Contract Number:
Meter Number:	MXU Number:
GPS Numbers:	Inspection Result
Meter Pit at Grade Level:	
Condition of Meter Pit:	
Condition of Meter:	
Condition of Backflow Preventor:	
Check Touch Pad Reading to Meter # to Case:	
Check Meters to Apartment on Duplex Homes:	

- 1) _____ Control Panel is mounted on side wall closest to Tank.
 _____ Panel is no lower than 3 feet from ground and not higher than 5 feet.
 _____ Both breakers inside panel are on.
 _____ Panel has a lock and sticker on front of panel.
- 2) _____ Service from house has cleanout 5 feet behind tank and cap is on.
 3) _____ Conduit is buried and damage free.
- 4) _____ Tank is level and there are no depressions around perimeter.
 _____ Pump is installed.
 _____ Vent hole is drilled and check valve is installed in the correct direction.
- 5) _____ Ball valve pit is installed and at the proper grade.
 _____ Ball valve is open.
 _____ Check for sod replacement and road damage from installation.

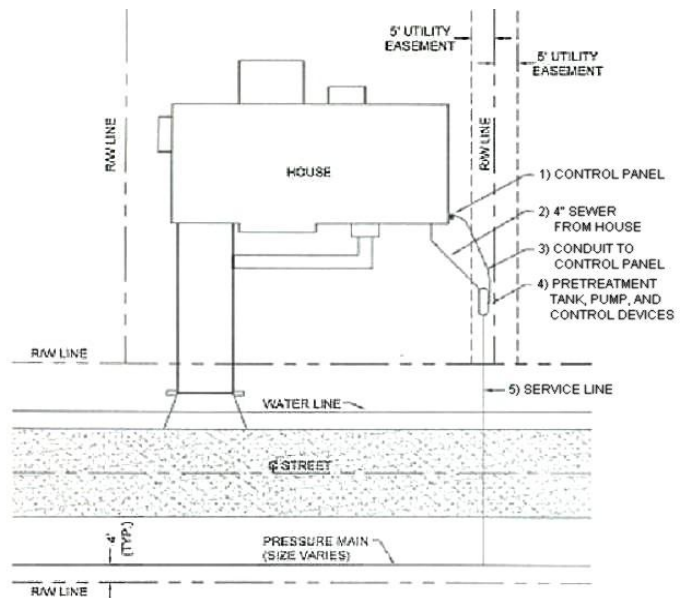

Comments: